Installation Instructions

4" Gravity Downlight (For use with IHOL-4D & GD4D)\

Covered by Patents: US10274148; CA2964801

WARNING

Risk of electrical shock. Disconnect power before servicing or installing luminaire.

▲ WARNING

Risk of injury or damage. Luminaire will fail if not installed properly. Follow installation instructions.

M WARNING

Risk of injury. Wear safety glasses and gloves during installation and servicing. Allow ample time to cool before handling.


IMPORTANT SAFETY INSTRUCTIONS

- Read all installation instructions before installing. It is important to save these instructions.
- Only install and connect LED module with power disconnected at the circuit breaker. Hot plugging, or connecting the module
 with power on, could damage the LEDs and is not covered by warranty.
- Connectors on modules and approved housings are keyed for specific voltage combinations; do not force or attempt to bypass
 connectors
- Observe and follow all label information and instructions regarding dry, damp and wet location listings, proper Intense LED module, warnings of installation near combustible materials and/or insulation.
- Turn off power at circuit breaker before attempting to install or perform maintenance on the fixtures.
- Be sure to connect ground wire to prevent electric shock or other potential hazards.
- The product must be installed in a manner consistent with the intended use and in compliance with the national electrical codes and local codes by a person familiar with the construction and operation of the product and the hazards involved.
- Do not block the trim aperture as this may cause unsafe operating conditions.
- WARNING: RISK OF FIRE. Non-IC fixture requires that insulation must be kept at least 3" away from all sides of the fixture.
 Minimum of 90°C supply conductors. Consult a qualified electrician before installation.

WARNING: Use only Intense Lighting trims listed for use with this fixture. Use of trims other than those listed by Intense Lighting is a violation of N.E.C 110-3(B) and voids all warranties.

HOUSING INSTALLATION:

- 1. Cut out the ceiling hole to 5 1/4" diameter.
- 2. Mount fixture housing according to ceiling type.
- Universal mounting bracket has slot openings for C-channel, flat bar, and ½" EMT; secure to joist or grid using fasteners or wire. C-channel hangers are recommended for T-Bar ceilings, install with notches facing down to engage T-Bar grid.



MOUNTING: Bar hanger mounting brackets offer several height choices depending on installation requirements. C-Channel, EMT (supplied by others) and other joist bars can be ordered for various ceiling types. 1100 (C-Channel) 1200 (Flat Bar)


Conduit knockout Junction box cover plate

ELECTRICAL CONNECTIONS:

Make electrical connections through desired knockout for conduit, MC and Romex[®] cable. Use only UL listed connectors (supplied by others).

EMT (supplied by others)

- Connect ground from fixture to green (GROUND) supply wire, white wire from fixture to
 white (NEUTRAL) supply wire and black wire from fixture to black (HOT) supply wire. Use
 UL listed connectors or wire nuts to make the connections (supplied by others). Connect
 dimming wires if applicable, see page 4.
- Close and lock junction box door ensuring all wire connections and wires are contained within.

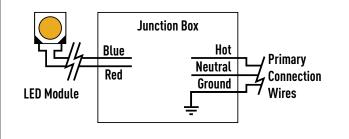






8/32 Fasteners


Installation Instructions

4" Gravity Downlight

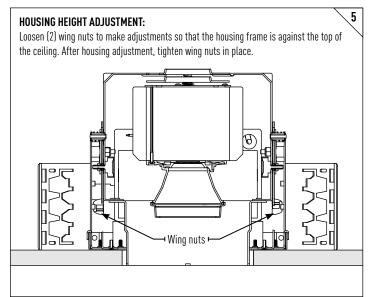

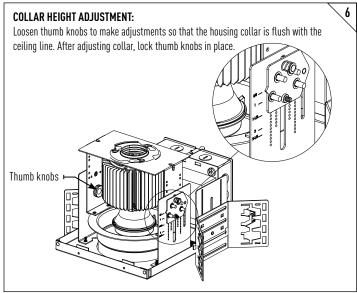

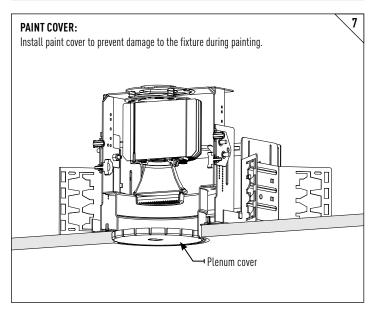

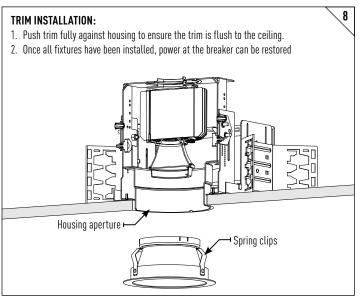

Spring clip


Installation Instructions

4" Gravity Downlight

SERVICING:

- 1. Remove trim from the housing.
- 2. Remove module by pushing up and turn counter clockwise. Disconnect 2-pin connector from junction box.
- 3. Push the spring clip on the junction box and unlock driver plate.


4. Remove driver plate from junction box and disconnect driver.

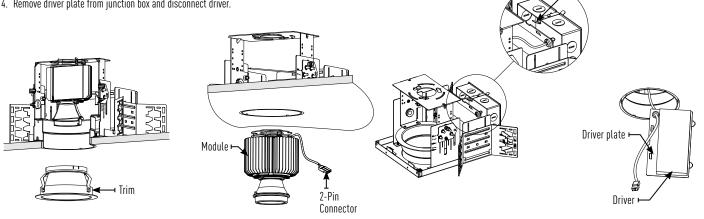

ACCESSORY HOLDER:


Note: Accessory holder can accommodate up to two accessories

- 1. Install accessories into accessory holder and replace accessory holder's retaining ring.
- 2. Push accessory holder against optic until accessory snaps onto optic.

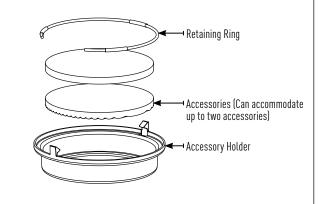

OPTIC REPLACEMENT:

- 1. Remove trim from housing.
- 2. Release optic by turning counter clockwise
- 3. Replace optic and lock into place by turning clockwise



NOTE: Do not touch the exposed LED surface (yellow pad)

WIRING & DIMMING COMPATIBILITY


For use with all Intense Lighting product with supported dimming options. Please check configuration of product for correct dimming protocol.

Phase Dimming or Lutron® LTEA2W Hi-Lume 2-Wire

- 120V Only
- Forward 1% / Reverse 5%

COMPATIBLE DIMMERS

Part Number(s)	<u>Type</u>
IPE04	Reverse
IPI06-1LZ	Forward
6633-P	Forward
DVELV300P	Reverse
DVCL-153P	Forward
S600P	Forward
DLC03P	Forward
DAL06P	Forward
	IP106-1LZ 6633-P DVELV300P DVCL-153P S600P DLC03P



0-10V Dimming

- 120V or 277V
- Dims down to 1% or 0.1% light output
- Consult dimming manufacturer for installation instructions and power packs

COMPATIBLE DIMMERS

Manufacturer Part Number(s)


HUNT PS-010-IV-120V, PS-010-WH-120V, PS-010-3W-IV-120, PS-010-3W-WH-120V, PS-010-IV-277V, PS-010-WH-277V, PS-010-3W-IV-277V, PS-010-3W-IV-277V, FD-010: PS-IFC-010-IV, PS-IFC-010-WH-120/277V, FD-010: PS-IFC-010-3W-IV,

PS-IFC-010-3W-WH-120/277V, FD-010-120V, FD-010-277V

Leviton Leviton Centura Fluorescent Control System, IllumaTech™ IP7 Series, DPSPE-212

Lightolier ZP600FAM120, MP1500FAM120, V2000FAMU Lithonia LEQ BC, LEQ LVBC, SLD LVBC, SQ1DC

Lutron DVTV, NTFTV Synergy ISD BC 120/277

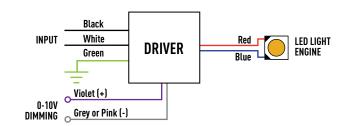

Lutron® LDE1 Hi-Lume EcoSystem


- 120V or 277V
- Dims down to 1%
- \blacksquare Consult dimming manufacturer for installation instructions

COMPATIBLE DIMMERS

Product Part Number(s)


EcoSystem CS-1L-WM, CS-2L-WM, CS-1L-CM, CS-2L-CM,

EcoSystem ESN, Grafik Eye QS with EcoSystem, Quantum

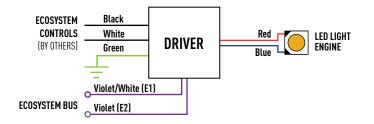

DMX512 RDM (Downlights with RJ45)

- 120V or 277V
- Dims Down to 0.1% Light Output
- RDM Channel Programmable

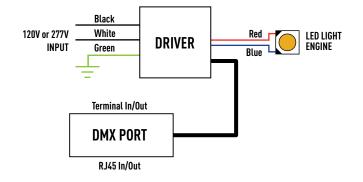




WIRING & DIMMING COMPATIBILITY

For use with all Intense Lighting product with supported dimming options. Please check configuration of product for correct dimming protocol.

DMX512 RDM (Cylinders without RJ45)

- 120V or 277V
- Dims Down to 0.1% Light Output
- RDM Channel Programmable

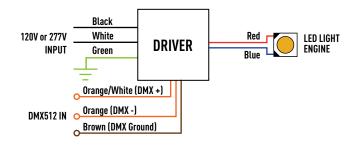

0-10V With Dynamic Beam

- 120V or 277V
- Dims down to 1% or 0.1% light output
- Consult dimming manufacturer for installation instructions and power packs

COMPATIBLE DIMMERS

Manufacturer Part Number(s)

HUNT PS-010-IV-120V, PS-010-WH-120V, PS-010-3W-IV-120, PS-010-3W-WH-120V, PS-010-IV-277V, PS-010-WH-277V, PS-010-3W-IV-277V, PS-010-3W-WH-277V,


FD-010: PS-IFC-010-IV, PS-IFC-010-WH-120/277V, FD-010: PS-IFC-010-3W-IV, PS-IFC-010-3W-WH-120/277V, FD-010-120V, FD-010-277V

Leviton Centura Fluorescent Control System, IllumaTech™ IP7 Series, DPSPE-212

Leviton

Lightolier ZP600FAM120, MP1500FAM120, V2000FAMU Lithonia LEQ BC, LEQ LVBC, SLD LVBC, SQ1DC

DVTV. NTFTV Lutron ISD BC 120/277 Synergy

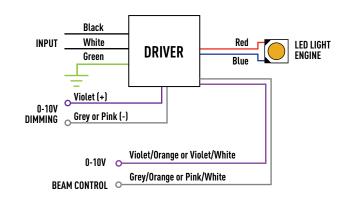

0-10V With Tunable White

- 120V or 277V
- Dims down to 1% or 0.1% light output
- Consult dimming manufacturer for installation instructions and power packs

COMPATIBLE DIMMERS

Manufacturer Part Number(s)

PS-010-IV-120V. PS-010-WH-120V. PS-010-3W-IV-120. PS-010-3W-WH-120V. HUNT


PS-010-IV-277V, PS-010-WH-277V, PS-010-3W-IV-277V, PS-010-3W-WH-277V, FD-010: PS-IFC-010-IV, PS-IFC-010-WH-120/277V, FD-010: PS-IFC-010-3W-IV,

PS-IFC-010-3W-WH-120/277V, FD-010-120V, FD-010-277V

Leviton Leviton Centura Fluorescent Control System, IllumaTech™ IP7 Series, DPSPE-212

ZP600FAM120, MP1500FAM120, V2000FAMU Lightolier LEQ BC, LEQ LVBC, SLD LVBC, SQ1DC Lithonia

Lutron DVTV, NTFTV ISD BC 120/277 Synergy

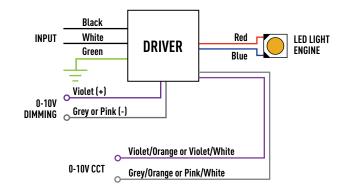

DALI With Tunable White

- 120V or 277V
- Dims down to 0.1%

