Installation Instructions 6" & 8" Gravity Cylinder Remote Emergency Backup - Surface Mount

-

_

-

WARNING

WARNING

Risk of electrical shock. Disconnect power

before servicing or installing luminaire.

Risk of injury or damage. Luminaire will

IMPORTANT SAFETY INSTRUCTIONS

on, could damage the LEDs and is not covered by warranty.

warnings of installation near combustible materials and/or insulation.

fail if not installed properly. Follow codes by a person familiar with the constr	r consistent with the intended use and in compliance with the national electrical codes and local ruction and operation of the product and the hazards involved. <i>Is listed for use with this fixture. Use of trims other than those listed by Intense Lighting is a</i> <i>arranties.</i>
A WARNING	
Risk of injury. Wear safety glasses and gloves during installation and servicing. Allow ample time to cool before handling.	
Attach MOUNTING BRACKET TO JUNCTION BOX: 1. 1. Attach the mounting bracket to junction box using hardware supplied with junction box. Image: Constraint of the mounting bracket to junction box using hardware supplied with junction box. Image: Constraint of the mounting bracket to junction box using hardware supplied with junction box. Image: Constraint of the mounting bracket to junction box using hardware supplied with junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mounting bracket to junction box. Image: Constraint of the mount of the mou	 ELECTRICAL CONNECTIONS: Attach the safety cable from the cylinder to split ring on the mounting bracket. Make electrical connections through center hole of the mounting bracket. Connect ground wire from mounting bracket to green (ground) supply wire and ground wire from fixture, black wire from cylinder to black (hot) supply wire and white wire from cylinder to white (neutral) supply wire. Use UL listed connectors or wire nuts (by others) to make the connections. Connect dimming wires if applicable, see page 3.
 MOUNTING CYLINDER TO MOUNTING BRACKET: Pull out the locking tab on the cylinder's top plate. Align the keyholes on the cylinder's top plate with the spring standoffs. Lift the cylinder into the spring standoffs and rotate the cylinder clockwise. 	3
4. Make sure the gap between the ceiling and cylinder is even to ensure the fixture is installed co	errectly. Even gap +


- Read all installation instructions before installing. It is important to save these instructions.

Be sure to connect ground wire to prevent electric shock or other potential hazards.

Only install and connect LED module with power disconnected at the circuit breaker. Hot plugging, or connecting the module with power

The product must be installed in a manner consistent with the intended use and in compliance with the national electrical codes and local

Observe and follow all label information and instructions regarding dry, damp and wet location listings, proper Intense LED module,

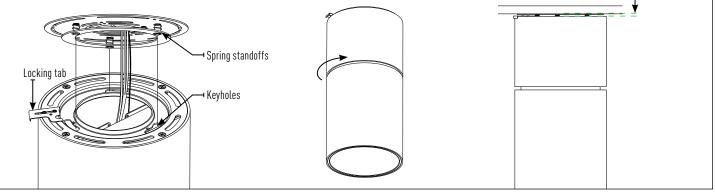


INSTRUCTIONS L/M-01132022 P-1



Installation Instructions


6" & 8" Gravity Cylinder Remote Emergency Backup - Surface Mount

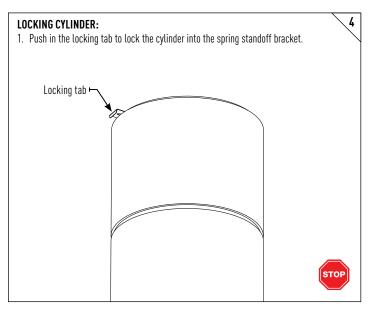


Remote Driver Housing Installation

REMOTE BOX INSTALLATION

- 1. Attach remote box at two 1/4" holes on 6 inch centers with frame in installation hardware (supplied by others)
- 2. Remove cover plate
- Remove required knockouts and run conduit to junction box fixture is attached to (**maximum 50 feet length from fixture")
- 4. Run connecting wires for LED driver class 2 by local and national electrical regulations, minimum 18 AWG wire and at maximum 50 feet length
- 5. Make electrical connections (see wiring diagram at the end of this document)
- 6. Reinstall cover plate with supplied 8-32 hardware, insure wires are clear of box edges not pinched or damaged when cover is screwed down

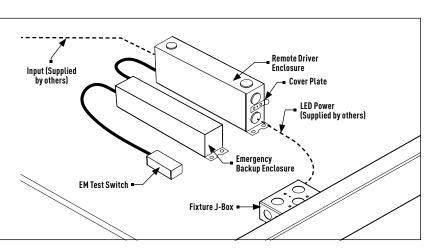

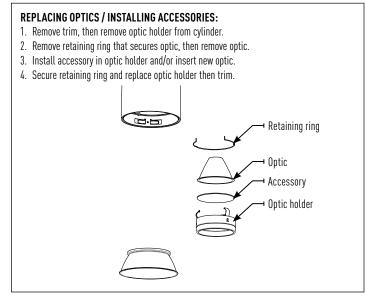

INSTRUCTIONS L/M-01132022 P-2

INTENSE LIGHTING | 3340 E La Palma Ave, Anaheim, CA 92806 | tel 714 630-9877 | fax 714 630-9883 For Intense Lighting's limited product warranty, go to www.intenselighting.com. For a printed copy of the warranty, you may call 800 961-5321. © 2022 Intense Lighting, LLC. All rights reserved. Note: This document is subject to change without notice.



WIRING & DIMMING COMPATIBILITY

For use with all Intense Lighting product with supported dimming options. Please check configuration of product for correct dimming protocol.

Phase Dimming or Lutron® LTEA2W Hi-Lume 2-Wire


e **EM ENCLOSURE** • 120V Only ۲ Forward 1% / Reverse 5% Orange / Black **COMPATIBLE DIMMERS TEST SWITCH** Product Part Number(s) <u>Type</u> Black **120V INPUT** DRIVER Reverse Leviton IPE04 **FROM DIMMER** White **ENCLOSURE** IPI06-1LZ Forward Leviton Blue(-) Red (+) 6633-P Leviton Forward Green DVELV300P Lutron Reverse Lutron DVCL-153P Forward S600P Lutron Forward LED LIGHT DLC03P Cooper Forward ENGINE Cooper DAL06P Forward

0-10V Dimming

- 120V or 277V
- Dims down to 1% or 0.1% light output
- Consult dimming manufacturer for installation instructions and power packs

COMPATIBLE DIMMERS

<u>Manufacturer</u>	<u>Part Number(s)</u>
HUNT	PS-010-IV-120V, PS-010-WH-120V, PS-010-3W-IV-120, PS-010-3W-WH-120V,
	PS-010-IV-277V, PS-010-WH-277V, PS-010-3W-IV-277V, PS-010-3W-WH-277V,
	FD-010: PS-IFC-010-IV, PS-IFC-010-WH-120/277V, FD-010: PS-IFC-010-3W-IV,
	PS-IFC-010-3W-WH-120/277V, FD-010-120V, FD-010-277V
Leviton	Leviton Centura Fluorescent Control System, IllumaTech™ IP7 Series, DPSPE-212
Lightolier	ZP600FAM120, MP1500FAM120, V2000FAMU
Lithonia	LEQ BC, LEQ LVBC, SLD LVBC, SQ1DC
Lutron	DVTV, NTFTV
Synergy	ISD BC 120/277

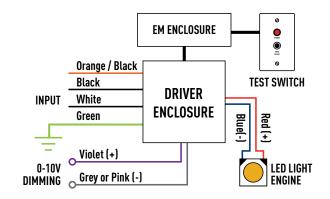


Lutron[®] LDE1 Hi-Lume EcoSystem

- 120V or 277V
- Dims down to 1%
- Consult dimming manufacturer for installation instructions

COMPATIBLE DIMMERS Product Part Number(s)

<u>Product</u> EcoSystem

CS-1L-WM, CS-2L-WM, CS-1L-CM, CS-2L-CM, EcoSystem ESN, Grafik Eye QS with EcoSystem, Quantum

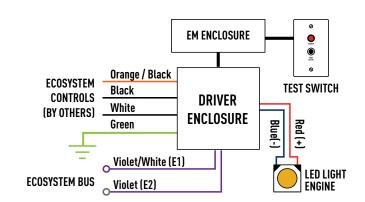





WIRING & DIMMING COMPATIBILITY

For use with all Intense Lighting product with supported dimming options. Please check configuration of product for correct dimming protocol.

DMX512 RDM (Cylinders without RJ45)

• 120V or 277V

DALI

120V or 277V

• Dims down to 0.1%

- Dims Down to 0.1% Light Output
- RDM Channel Programmable

